

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA



NATIONAL INSTITUTE FOR
COMMUNICABLE DISEASES

Division of the National Health Laboratory Service


WEEK 49

OVERVIEW

This report summarises and interprets findings from detection and quantification of SARS-CoV-2 levels by the NICD Centre for Vaccines and Immunology in influent (untreated) wastewater in 18 wastewater treatment plants (WWTP) across five provinces tested by the NICD, and 77 additional plants tested by SACCESS partners including the National Institute for Occupational Health, Lumegen Laboratories, GreenHill Laboratories and Praecautio to cover all provinces. Levels of SARS-CoV-2 in wastewater correlate with population levels of SARS-CoV-2 over time and indicate the geographic distribution of disease. SARS-CoV-2 is shed from symptomatic and asymptomatic persons in stool but is not transmitted by faecal-oral route nor via wastewater. This report is based on data collected from June 2020 up until the week ending 10th December 2021 (epidemiological week 49). Generally, levels of SARS-CoV-2 are increasing across the country corresponding to the increase in clinical cases. Detailed analyses are described below.

HIGHLIGHTS

- Our recent results show variable levels of SARS-CoV-2 in wastewater. While consistent increases in SARS-CoV-2 levels are noted in some plants, others are beginning to show marginal decreases, with corresponding increases and decreases in clinical cases, respectively. More samples in subsequent weeks will confirm the trend in the latter.
- Areas with increases in SARS-CoV-2 levels include:
 - **Gauteng Province**
 - ◊ In the City of Johannesburg, despite the decline in clinical caseload, the SARS-CoV-2 levels continue to increase over five consecutive weeks (weeks 44-49) in Goudkoppies (Soweto). This continuous increase in levels may indicate continuous shedding of the virus by asymptomatic cases. The levels at Northern and Ennerdale WWTPs are also increasing.
 - ◊ In Ekurhuleni East, the SARS-CoV-2 levels are seen to be increasing at Rynfield and Vlakplaats WWTPs.
 - **KwaZulu-Natal:**
 - ◊ The SARS-CoV-2 levels continue to increase or remain stable in some plants in eThekweni: Four increases in SARS-CoV-2 in wastewater levels were detected between weeks 44-48 in Central WWTP and two successive increases in the Northern WWTP, paralleling the increase in clinical cases.
 - **Free State**
 - ◊ Current results show that SARS-CoV-2 levels continue to increase in Bloemspuit and Sterkwater WWTPs, each showing three successive increases, corresponding to increases in clinical cases.
 - **Eastern Cape Province**
 - ◊ In Buffalo City Metro, SARS-CoV-2 levels from Zwelitsha have increased successively over two weeks with a corresponding increase in caseload. The levels in Mdantsane, East Bank, Potsdam, and Gonubie may be increasing, but more recent results are required.



WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

- **Western Cape Province**

- ◊ The SARS-CoV-2 levels in Zandvleit showed three successive increases between weeks 45-48 paralleling the increase in the number of clinical cases. More recent samples are required

- The areas showing a marginal decrease in the SARS-CoV-2 levels include:

- **Gauteng Province:**

- **Tshwane District:**

- ◊ The SARS-CoV-2 levels in Daspoort (which drains Pretoria central) have shown two successive decreases from week 47 with a corresponding decrease in clinical cases.
 - ◊ The levels in Sunderland WWTP may be decreasing but will require more samples for confirmation.
 - ◊ To the North, the levels at Temba, Rooiwal, and Bebelegi WWTPs may be decreasing, with a corresponding decrease in clinical cases, but will require more samples for confirmation.
- In Ekurhuleni North, the levels at Hartebeesfontein WWTP have decreased over two weeks corresponding to the declining caseload.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

DETECTION AND QUANTITATION OF SARS-COV-2 AT SENTINEL WASTEWATER TREATMENT SITES IN SOUTH AFRICAN URBAN AREAS, MARCH- DECEMBER 2021

CO-FUNDED BY THE WATER RESEARCH COMMISSION AND THE NICD

Kerrigan McCarthy^{1,2}, Said Rachida¹, Nkosenhle Ndlovu¹, Chinwe Iwu-Jaja¹, Mukhlid Yousif^{1,3}, Wayne Howard¹, Shelina Moonsamy¹, Gina Pocock⁴, Leanne Coetzee⁴, Janet Mans⁵, Lisa Schaefer⁶, Wouter J. Le Roux⁶, Annancietar Gomba⁷, Don Jambo⁷, David Moriah de Villiers⁸, Nadine Lee Lepart⁸, Shaun Groenink⁹, Neil Madgwick¹⁰, Martie van der Walt¹¹, Awelani Mutshembele¹¹, Faizal Bux¹², Isaac Dennis Amoah¹², Natacha Berkowitz¹³, Jay Bhagwan¹⁴, Melinda Suchard^{1,15} for the South African Collaborative COVID-19 Environmental Surveillance System (SACCESS) network.

1. Centre for Vaccines and Immunology, National Institute for Communicable Diseases, a division of the National Health Laboratory Service, South Africa
2. School of Public Health, University of the Witwatersrand, Johannesburg
3. Department of Virology, School of Pathology, University of the Witwatersrand, Johannesburg
4. Waterlab, (Pty) Ltd, Pretoria;
5. Department of Medical Virology, University of Pretoria
6. Water Centre, Council for Scientific and Industrial Research (CSIR), Pretoria
7. National Institute for Occupational Health, a division of the National Health Laboratory Service, Johannesburg
8. Lumegen Laboratories, (Pty) Ltd, Potchefstroom
9. Greenhill Laboratories
10. Praecautio
11. Tuberculosis Platform, South African Medical Research Council, Pretoria.
12. Institute of Wastewater Management, Durban University of Technology
13. City of Cape Town Health Department
14. Water Research Commission, Pretoria
15. Department of Chemical Pathology, School of Pathology, University of the Witwatersrand, Johannesburg

BACKGROUND

The detection and monitoring of SARS-CoV-2 through wastewater was first proposed in April 2020. Initial reports describing the feasibility and practical usefulness of this approach emerged simultaneously from several countries during August 2020. Recent evidence has shown that SARS-CoV-2 can be detected in wastewater prior to the appearance of clinical cases, and longitudinal tracking of SARS-CoV-2 viral load in wastewater correlates with the burden of clinically diagnosed cases. Sequencing of SARS-CoV-2 RNA fragments in wastewater has identified variants of concern as well as mutations not detected in clinical cases.

In South Africa, SARS-CoV-2 epidemiology is monitored through laboratory testing of clinical cases using reverse-transcriptase polymerase chain reaction (RT-PCR) tests and rapid antigen tests, COVID-19 hospital admissions and COVID-19 - related deaths. Laboratory testing data is relayed by testing laboratories to the National Institute for Communicable Diseases (NICD) via the DATCOV system. From these data sources,

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

epidemiological indicators including incidence rates of testing and case detection, hospitalisation and death rates are made available to key stakeholders and the general public.

Clinical epidemiology based on reporting of laboratory-confirmed cases of SARS-CoV-2 has limitations. Household transmission studies in South African urban and rural settings have demonstrated that a large proportion of cases are asymptomatic or so mild as not to elicit health seeking, and that laboratory-confirmed cases likely represent less than 10% of SARS-CoV-2 cases prevalent in a community at any given time. Secondly, there is increasing use of rapid antigen detection tests in clinical settings. Results of these tests may not be reported to surveillance networks. Consequently, laboratory diagnosis is increasingly less representative of the burden of disease.

In November 2020, a network of testing laboratories, which became known as the South African Collaborative COVID-19 Environmental Surveillance System (SACCESS) network, was established in order to support the development of a common testing methodology, identify and address challenges, and share best practices related to qualitative, quantitative and RNA sequencing of SARS-CoV-2 in wastewater. Treatment of wastewater in South Africa is the responsibility of local government. Approximately 1050 wastewater treatment works (WWTPs) are administered by metropolitan councils and local government and treat industrial and domestic waste. SACCESS partners and the NICD have engaged with local government to support sample collection, interpretation and utilisation of the results for public health purposes.

The SACCESS network aims to detect and quantify SARS-CoV-2 in wastewater in urban settings in South Africa, to compare trends, temporal and geographic distribution of SARS-CoV-2 levels in wastewater with trends in clinical epidemiology so as to support the use of wastewater-based epidemiology for COVID-19 outbreak prevention and response activities.

METHODS

Outbreak context and clinical case epidemiology

Since the first case of SARS-CoV-2 in South Africa was detected on 3rd March 2020, laboratories in the country have conducted over 18 million RT-PCR and antigen tests. Four distinct waves of SARS-CoV-2 infection have occurred, peaking in June 2020, December 2020, July 2021, and December 2021, respectively. The current de-duplicated and geospatially allocated national line list of laboratory-confirmed cases of SARS-CoV-2 (identified by RT-PCR or antigen test) is provided by the NICD for comparison with results from SARS-CoV-2 testing of wastewater.

Establishment of the laboratory testing network

Commencing in 2018, the NICD had been conducting testing of wastewater for poliovirus as part of the National Department of Health's polio surveillance programme. In 2020, the NICD commenced testing of influent wastewater samples from these 18 sites, including eight in Gauteng Province, two in the City of Cape Town (Western Cape Province), two in Mangaung (Free State Province), two in eThekweni (KwaZulu-Natal Province) and four in Eastern Cape Province (two in Buffalo City Metro and two in Nelson Mandela Metro). Quantitative testing results for these sites are available from week 8 of 2021, onwards.

Additional plants across all metropolitan areas as well as sentinel site plants in smaller provinces were included from February 2021. From August 2021, quantitative testing was conducted on all specimens submitted to partner laboratories for testing. Presently, samples from 95 WWTPs are being tested for SARS-CoV-2

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

SARS-CoV-2 detection and quantitation methodology

At the identified wastewater treatment facilities, one litre grab samples of influent are collected and transported at <5°C to the testing facility. Table 1 summarises the sample collection, concentration, RNA extraction and PCR methods for partner laboratories. A positive PCR test result is defined as detection of any SARS-CoV-2 gene target (amongst the N, E or RdRP genes). A negative PCR test is defined as a positive internal control without a positive N, E or RdRP gene target. An invalid test result is defined as failure to detect the N, E or RdRP genes along with a negative internal control. Quantitative PCR results in genome copies/ml were log-transformed when graphed. All RT-PCR detection methodologies use in-built positive and negative controls to eliminate processing errors or contamination. Quantitative testing (in copies/ml of wastewater) is conducted by the NICD using a fourplex RT-qPCR assay. The Allplex 2019-nCoV assay (Seegene, catalogue number RP10243X) includes proprietary primers and probes that amplify the E, N and RdRP genes. The assay also amplifies an internal control that helps monitor for PCR inhibition. Standard curves, from which SARS-CoV-2 copy numbers are calculated, are constructed using the EDX SARS-CoV-2 Standard (Exact Diagnostic, catalogue number COV019) consisting of synthetic RNA transcripts containing the E, N and RdRP genes.

Table 1. Concentration, extraction and RT-PCR detection methodology used by laboratory partners, South African Collaborative COVID-19 Environmental Surveillance System (SACCESS) network.

Method for virus concentration	Method for virus concentration	Method for nucleic acid extraction	RT-PCR assay	Quantification
NICD	Centricon® Plus-70 centrifugal	QIAamp® viral RNA mini kit	Allplex™ 2019-nCoV Assay	EDX SARS-CoV-2 Standard including RNA transcripts of E, N and RdRP genes
GreenHill Laboratories / Praecautio	Ultrafiltration (Amicon® Ultra-15 Centrifugal Filter Unit)	Omega Bio-Tek Mag-Bind® Viral DNA/RNA 96 Kit	CDC 2019-Novel Coronavirus (2019-nCoV) Real-Time RT-PCR Diagnostic Panel	Relative quantification based on CDC 2019-Novel Coronavirus (2019-nCoV) Real-Time RT-PCR Diagnostic Panel
NIOH	Skim milk flocculation	MagMAX Viral and Pathogen Nucleic Acid Isolation Kit	TaqPath COVID-19 CE-IVD RT-PCR Kit Thermo Fisher	Standard curve method using TaqPath kit positive control
Waterlab/UP	Skim milk flocculation	QIAamp® Ultrasens® Virus kit	QuantiFast® Pathogen RT-PCR + IC kit (Qiagen) with 2019-nCoV-N1 primers and probe	Standard curves using the 2019_nCoV_N positive control plasmid (Integrated DNA Technologies, Inc, Coralville, IA)
SAMRC-BRIP	Centrifugation	RNeasy PowerSoil	2019-nCoV CDC EUA Kit	
SAMRC-TB PLATFORM	Centrifugation	ZymoBiomixs RNA Extraction Kit	AllPlex 2019-nCoV Assay	EDX SARS-CoV-2 Standard including RNA transcripts of E, N and RdRP genes
Lumegen	Passive sampling + resuspension in PBS	MN DNA/RNA pathogen extraction Kit	TaqPath COVID-19 CE-IVD RT-PCR Kit (Thermo Fisher)	5-point standard curve of the TaqPath positive control
CSIR	Polyethylene Glycol	Omega Bio-tek EZNA total RNA Kit II	2019-nCoV CDC EUA Kit	Relative quantification based on the 2019-nCoV CDC positive control.

*RT-PCR=reverse transcriptase polymerase chain reaction; Ct=cycle threshold

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

Interpretation of SARS-CoV-2 levels in wastewater

Interpretation of SARS-CoV-2 wastewater levels is evolving. We have elected to use interpretive principles outlined in Table 2 to support public health preparedness and response activities. In general, increasing or decreasing trends in levels are reported based on two or more results, as a single sample that increases or decreases compared with the result from the previous week may represent an outlier. Small changes (up to 0.5log copies/ml) are not regarded as significant changes unless they form part of a general upward or downward trend. Comparison of results over time when quantification is done by the same laboratory using the same quantitative methodology is meaningful. The use of different methodologies by different laboratories precludes comparison of quantitative results across laboratories.


Table 2. Principles of SARS-CoV-2 detection and quantification on influent samples from wastewater treatment plants and interpretive principles to guide application of test results to support COVID-19 public health responses, South Africa.

Testing modality	Interpretive principles to support public health responses
Detection of SARS-CoV-2	<p>When a test result changes from</p> <ul style="list-style-type: none"> positive to negative, this signifies fewer/no cases in population negative to positive, this indicates the need for increased population awareness and action Qualitative results (presence or absence) are comparable between laboratories
Quantification of SARS-CoV-2	<p>The concentration of SARS-CoV-2 at a particular facility may be used to infer the burden of SARS-CoV-2 in the population served by the wastewater treatment facility. Changes in the concentration of SARS-CoV-2 give an indication of whether the burden of disease is increasing or decreasing. Quantitative results between laboratories are not comparable. Quantitative results should be interpreted for a single wastewater treatment plant tested by the same laboratory using the same methodology over time.</p>

RESULTS

Gauteng Province

A: City of Tshwane South (sub-districts 3, 4, 6, and 7)

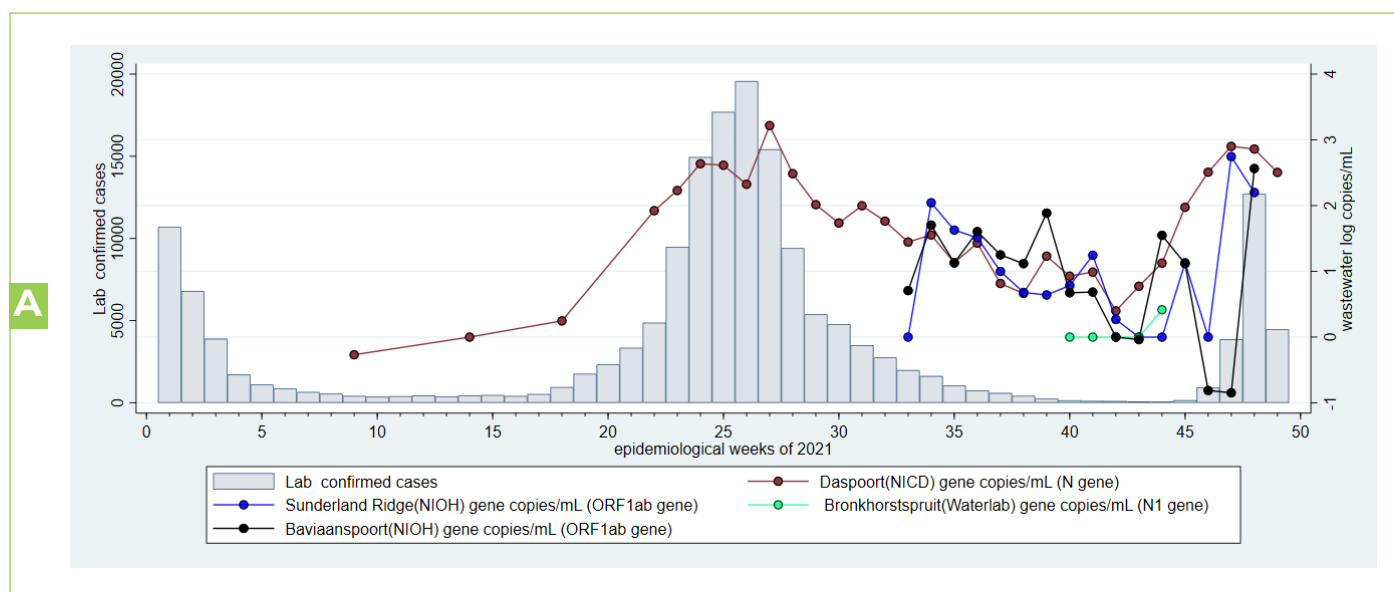

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

B: City of Tshwane North (sub-districts 1, 2, 5)

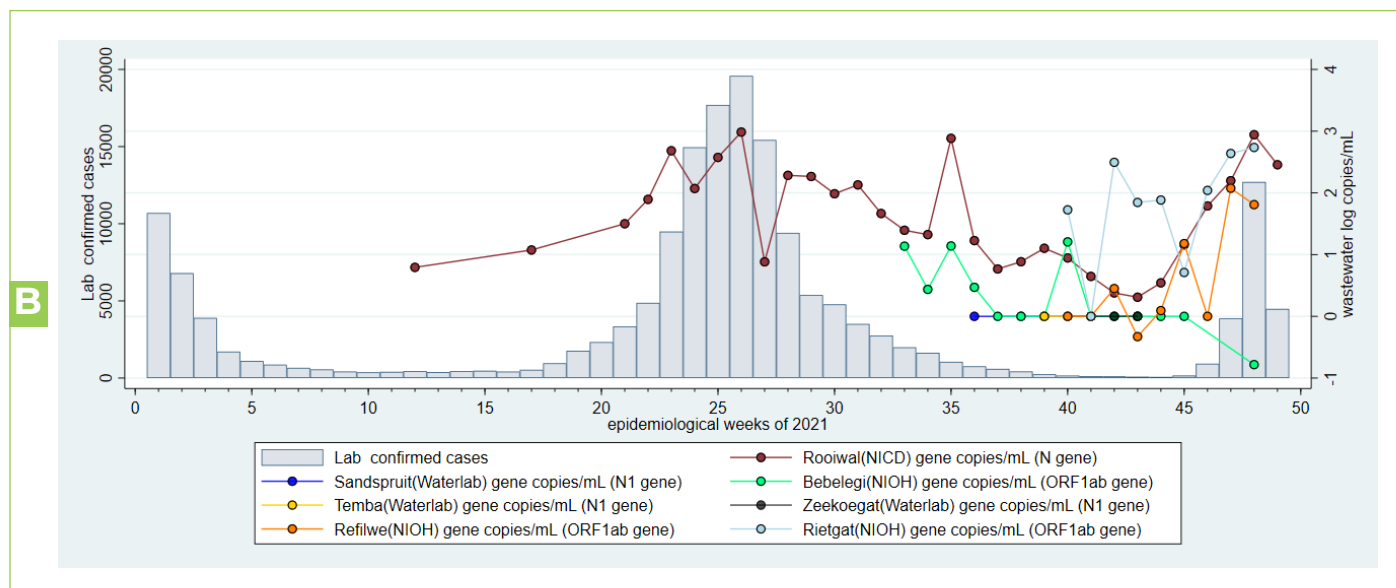


Figure 1 A-B. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) for selected wastewater treatment plants (WWTP) and metropolitan areas in Tshwane District Municipality (Tshwane South and North), Gauteng Province during epidemiological weeks 1-49, 2021. The testing laboratory and quantified SARS-CoV-2 gene is named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be done for specimens tested in the same laboratory.

C: City of Johannesburg Metropolitan Municipality


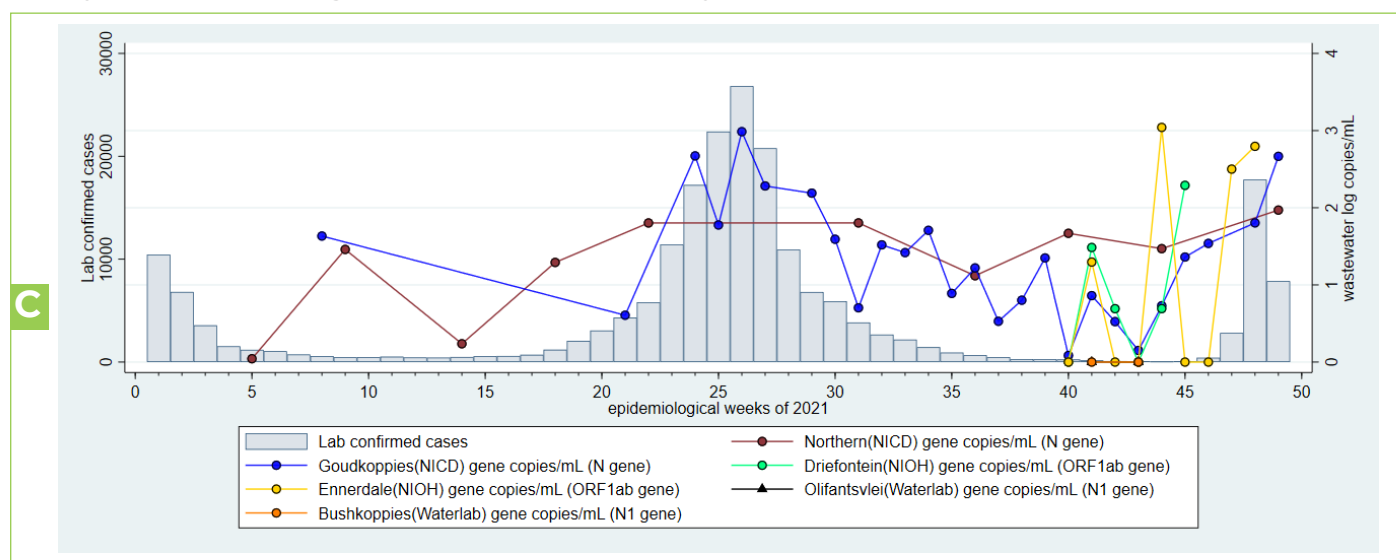


Figure 1 C. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) for selected wastewater treatment plants (WWTPs) in the City of Johannesburg Metropolitan Municipality, Gauteng Province during epidemiological weeks 1-49, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels overtime should only be made for specimens tested in the same laboratory.


WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

D: Ekurhuleni East (sub-districts D, E or E1, E2)

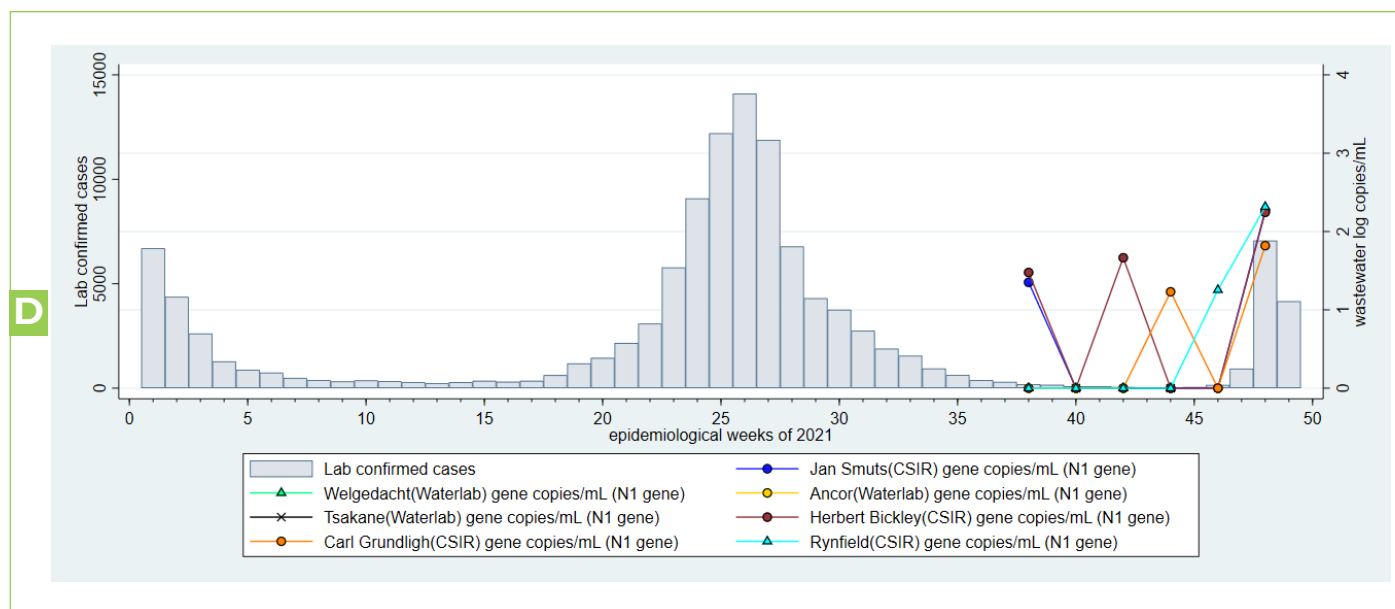

E: Ekurhuleni South (sub-districts A, F or S1, S2)

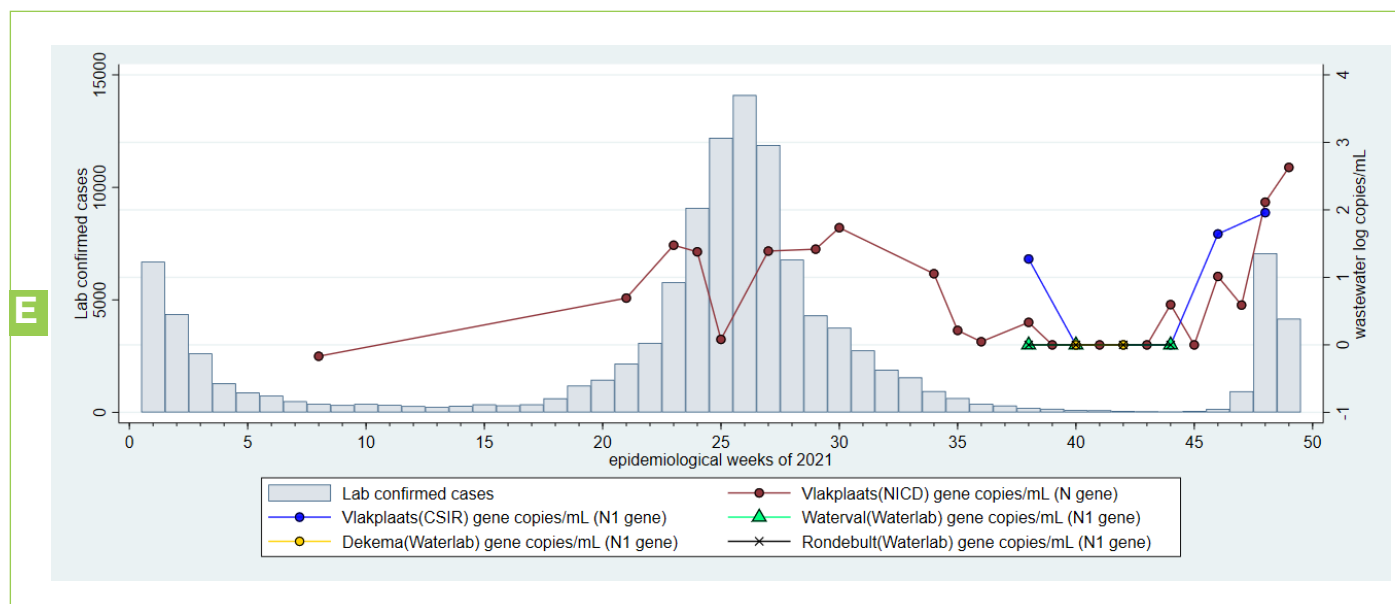

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

F: Ekurhuleni North (sub-districts B,C or N1,N2)

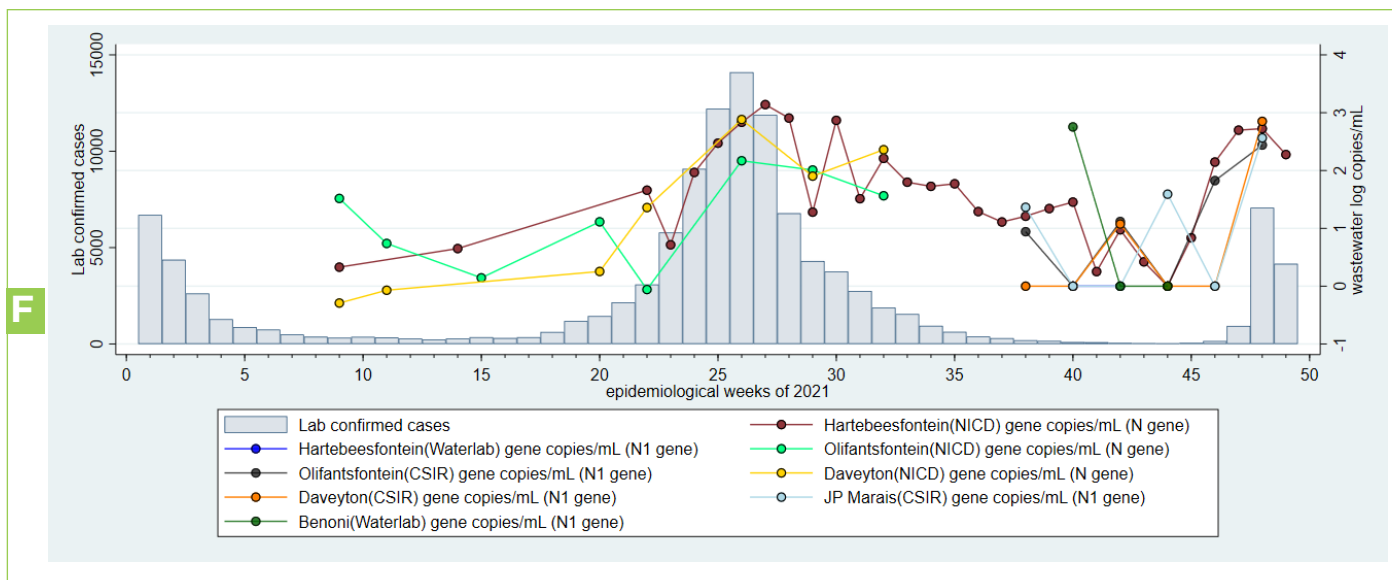


Figure 1 D-F. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) for selected wastewater treatment plants (WWTP) in Ekurhuleni Metropolitan Municipality, Gauteng Province during epidemiological weeks 1-49, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.

G: West Rand District Municipality

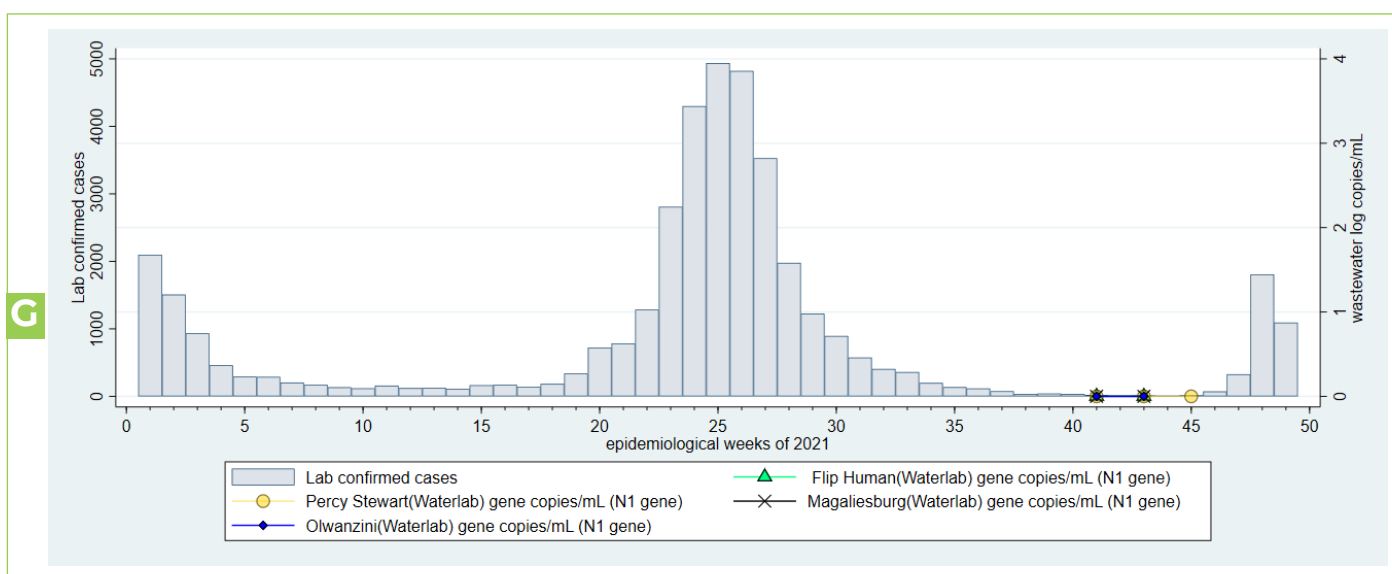


Figure 1 G. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) for selected wastewater treatment plants (WWTP) in West Rand District Municipality, Gauteng Province during epidemiological weeks 1-45, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

In Gauteng province, wastewater testing for SARS-CoV-2 is currently being conducted in four district municipalities: the City of Tshwane, the City of Johannesburg, Ekurhuleni and West Rand laboratories, namely NICD, NIOH, CSIR, and Waterlab. The figures above are arranged to reflect the geographical locations of the wastewater treatment plants.

In Tshwane District Municipality, SARS-CoV-2 levels are being monitored in 11 treatment plants in Tshwane South and North (Figures 1A-B). In Tshwane South, the NICD tests SARS-CoV-2 levels at Daspoort, the Waterlab at Bronkhortspruit while the National Institute for Occupational Health (NIOH) tests at Sunderland Ridge and Baviaanspoort. In Tshwane North, the NICD is testing at Rooiwal, while the NIOH is testing at four WWTPS, namely, Refilwe, Rooiwal, Bebelegi, and Rietgat. Waterlab is testing at three WWTPS namely, Sandspruit, Temba, and Zeekoegat.

Quantitative testing by the NICD commenced in epidemiological weeks 9 and 12 at Daspoort and Rooiwal WWTPS, respectively. Quantitative testing by the NIOH began in epidemiological week 33 in Baviaanspoort, Sunderland Ridge, and Bebelegi and week 40 in Refilwe and Rietgat. Testing by the Waterlab started in week 32 in Bronkhortspruit, week 36 in Sandspruit, week 39 in Temba, and week 40 in Zeekoegat (Figures 1A-1B).

In the City of Johannesburg (Figure 1C), quantitative testing by the NICD began in epidemiological week 5 in two WWTPS (Goudkoppies and Northern); week 40 by the NIOH in two WWTPS (Driefontein and Ennerdale); and week 41 by the Waterlab in two WWTPS (Bushkoppies and Olifantsvlei).

In Ekurhuleni (Figures 1D-F), quantitative testing is currently being done in the Eastern, Southern, and Northern parts. In the Eastern part, testing is done in Welgedacht, Tsakane and Ancor WWTPS. In the Northern part, testing is being done in Hertebesfontein, Benoni, Olifantsfontein, Daveyton and JP Marais. In the Southern part, testing is done in Vlakplaats, Dekema, Waterval and Rondebult WWTPS.

Testing by CSIR (Figure 1D-F) began in epidemiological week 38 of 2021 in four WWTPS (Herbert Bickley, Jan Smuts, and JP Marais and week 44 in two WWTPS (Carl Grundligh and Rynfield). The CSIR is also testing at Daveyton, Olifantsfontein and Vlakplaats, with testing commencing in weeks 42, 38, and 38, respectively (Figure 1E). Quantitative testing commenced by the NICD in epidemiological week 8 in Vlakplaats, and week 9 in three treatment plants (Daveyton, Hartebeesfontein and Olifantsfontein) (Figure 1E-F). The Waterlab (Fig 1E-F) began testing of two WWTPS in week 38 (Rondebult and Welgedacht) and week 40 in five WWTPS (Ancor, Dekema, Hartebeesfontein, Tsakane and Waterval, and Benoni).

In West Rand (Figure 1G), Waterlab is currently testing three WWTPS (Flip Human, Magaliesburg, and Percy Stewart). Testing in all these WWTPS commenced in week 41.

In Tshwane District, recent results from SARS-CoV-2 levels in wastewater are beginning to decrease. In Tshwane South, levels in Daspoort (which drains Pretoria central) have shown two successive decreases from week 47. Similarly, the levels in Sunderland WWTP may be decreasing but will require more samples for confirmation. To the North, levels at Temba, Rooiwal and Bebelegi may be decreasing, with a corresponding decrease in clinical cases, but will require more samples for confirmation.

In the City of Johannesburg, there has been consistent increases in SARS-CoV-2 levels, over five consecutive weeks (weeks 44-49) in Goudkoppies (Soweto). The SARS-CoV-2 levels seemed to have been increasing in Driefontein between week 43-45, but more recent samples are needed. Similarly, the levels at Northern and Ennerdale are increasing.

In Ekurhuleni East, the SARS-CoV-2 levels are seen to be increasing at Rynfield WWTP, while Herbert Bickley, Carl Grundligh maybe increasing but will require more samples. To the South, the SARS-CoV-2 levels in Vlakplaats WWTP to the South continue to increase from week 46. However, Hartebeesfontein WWTP to the North, has shown decreases over two weeks corresponding to the declining case load. The SARS-CoV-2 levels in Olifantsfontein WWTP showed consistent increases over three weeks between weeks 45-47, but will require more recent samples.


In all, public health authorities are required to continue to sensitize the public, strengthen clinical surveillance in these areas, promote vaccination and non-pharmaceutical interventions.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

KwaZulu-Natal Province

2A: eThekweni Metropolitan Municipality

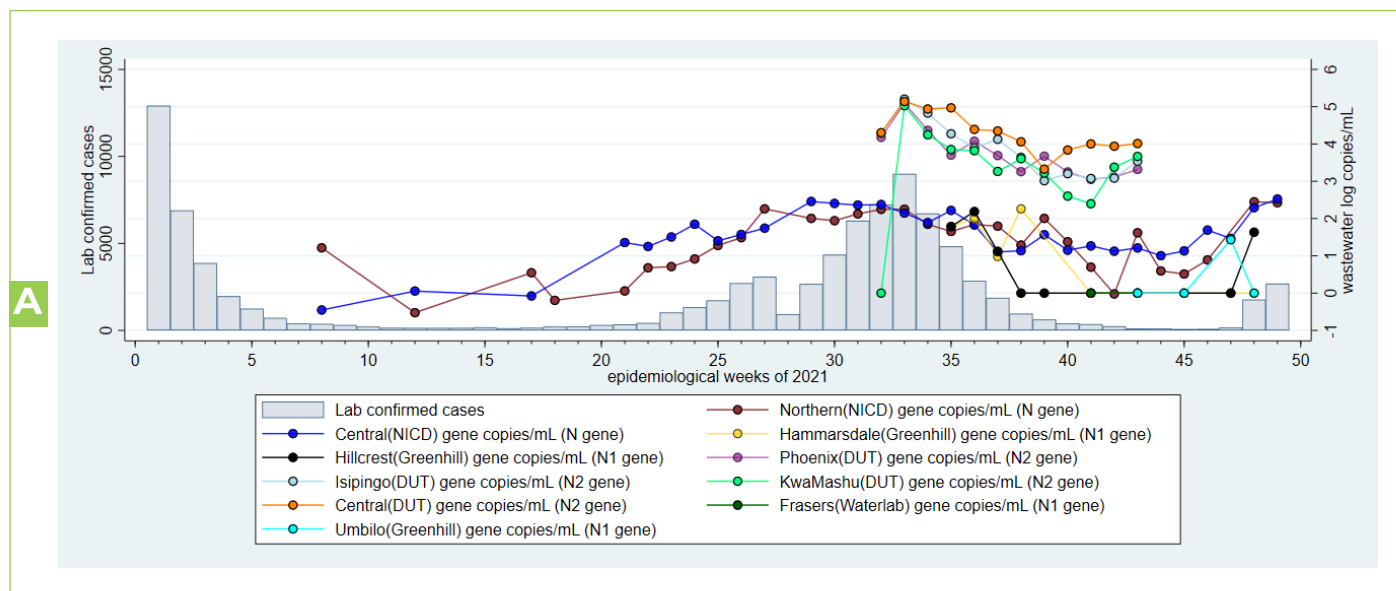

B: uMgungundlovu District Municipality

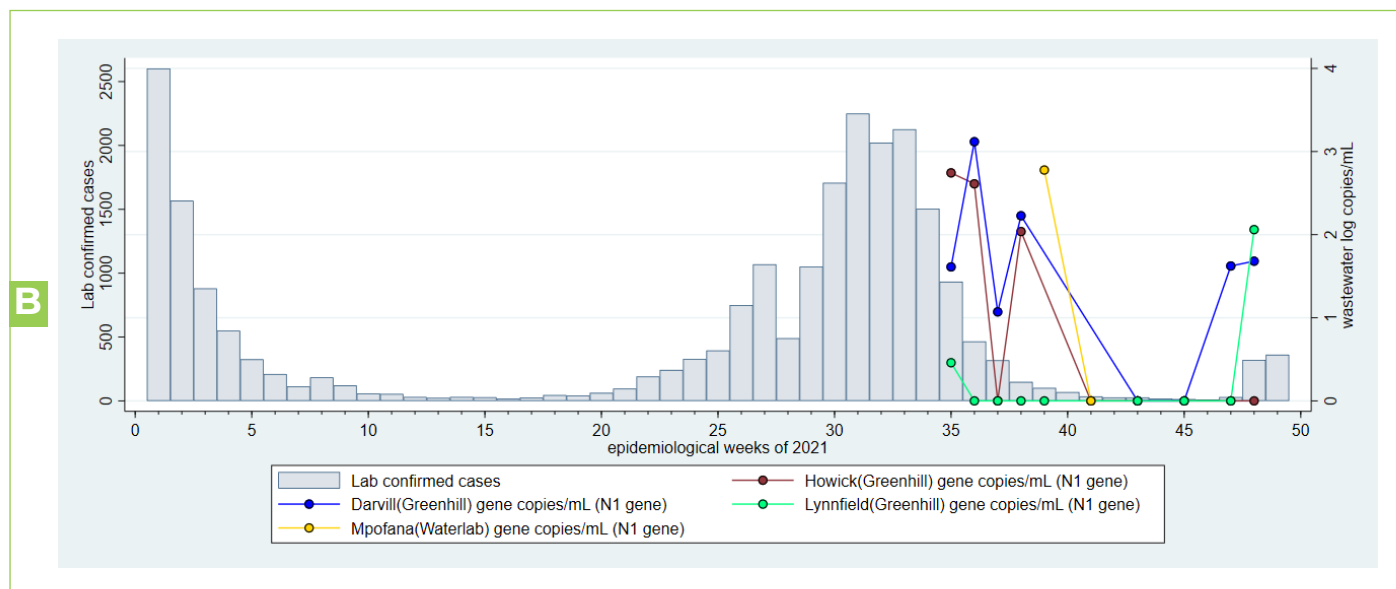


Figure 2A-B. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) from wastewater treatment plants (WWTP) in Ethekeeni, (A-B) and uMgungundlovu Metro (C), KwaZulu Natal Province during epidemiological weeks 1-48, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

In eThekweni (Figure 2A), quantitative testing is conducted by the NICD, GreenHill Laboratory, Durban University of Technology (DUT), and Waterlab. Quantitative testing by the NICD commenced in epidemiological week 8 2021 at two WWTPs, Central and Northern. Quantitative testing by GreenHill Laboratory began in weeks 34 and 35, 2021, at the Hillcrest and Hammarsdale WWTPs, respectively. The DUT began testing four WWTPs (Isipingo, Phoenix, Central, and KwaMashu) in week 32, 2021. Waterlab commenced testing at Frasers WWTP in Ballito in week 41, 2021.

In uMgungundlovu (Figure 2C), quantitative testing is being done by GreenHill Laboratories and waterlab. Testing by GreenHill Laboratory commenced in epidemiological week 35 in three WWTPs (Darvill, Howick, and Lynnfield). Waterlab began testing in Mfofana WWTP in week 39, 2021.

SARS-CoV-2 levels tested by DUT are consistently 2-3 log copies/ml higher than those tested by the NICD. This may be accounted for by the fact that DUT is using a more sensitive methodology for PCR detection, namely digital droplet PCR. It also highlights the interpretive principle that comparisons of levels should only be made on specimens tested in the same laboratory using the same test methodology.

The SARS-CoV-2 levels continue to increase or remain stable in some plants in eThekweni: Four increases in SARS-CoV-2 in wastewater levels were detected between weeks 44-48 in Central WWTP (tested by DUT), and two successive increases in the Northern WWTP, paralleling increase in clinical cases. The levels at Darvill and Lynnfield WWTPs in Umgungundlovu may be increasing requiring more recent samples for confirmation. Therefore, public health authorities should continue to strengthen surveillance for cases, promote vaccination and non-pharmaceutical interventions. The SARS-CoV-2 levels in other WWTPs in both eThekweni and uMgungundlovu tested from week 42-48, 2021 remained low or stable, paralleling the decrease in clinical cases. However, more recent samples will be required for confirmation. Two successive increases were also observed in samples from KwaMashu, Phoenix and Isipingo (southern eThekweni) between weeks 42-43. However latest results are required.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

Free State Province

A: Mangaung Metropolitan Municipality

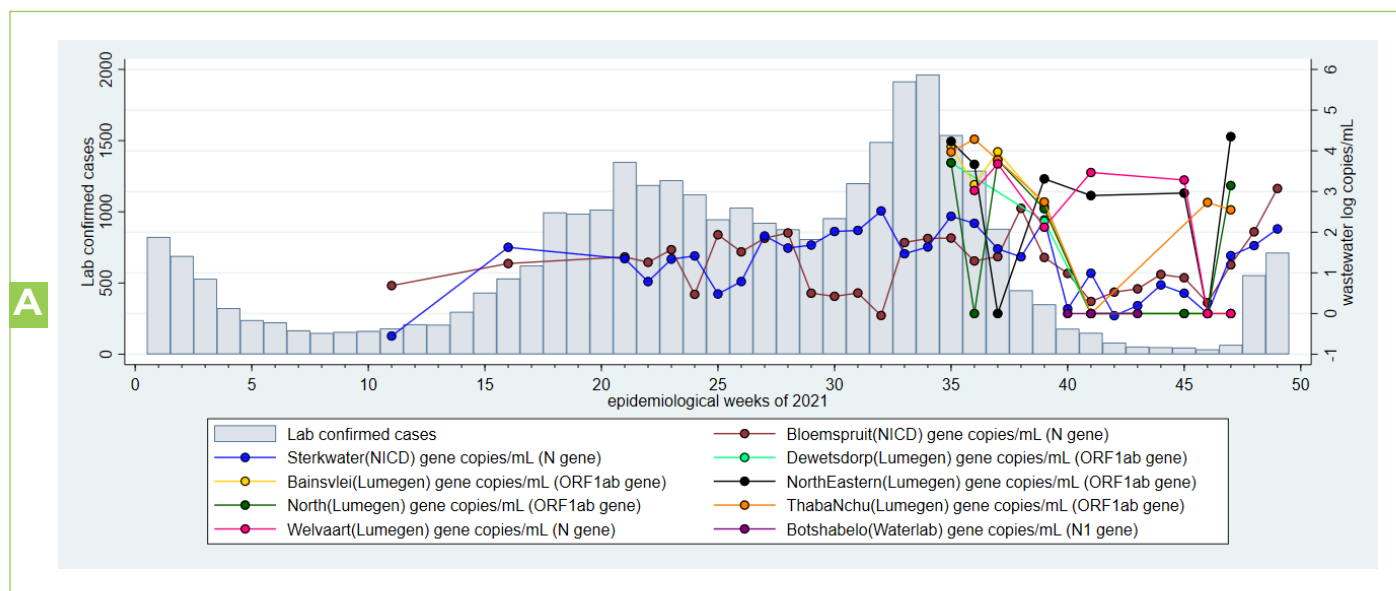


Figure 3A. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) from wastewater treatment plants (WWTPs) in Mangaung, Free State Province during epidemiological weeks 1-49, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.

In Free State, the monitoring of wastewater levels of SARS-CoV-2 is being conducted at nine WWTPs in Mangaung district municipality by the NICD, Lumegen, and Waterlab laboratories. Quantitative testing by the NICD (Figure 3A) commenced in epidemiological week 11, 2021, at two WWTPs (Bloemspruit and Sterkwater). Quantitative testing by Lumegen Laboratories commenced in epidemiological week 35 of 2021 in five wastewater treatment plants (ThabaNchu, North, Northeastern, Dewetsdorp, and Bainsvlei) and week 36 in Welvaart WWTP. Waterlab commenced testing in Botshabelo WWTP in epidemiological week 40 of 2021.

Current results show that SARS-CoV-2 levels continue to increase in Bloemspruit and Sterkwater WWTPs, each showing three successive increases, corresponding to increases in clinical cases. The levels from North and NorthEastern WWTPs may be increasing but more recent samples are required. The public health authorities should continue to strengthen surveillance for cases, promote vaccination and non-pharmaceutical interventions. Sampling frequency in other Mangaung plants will be increased to weekly to monitor trends more closely.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

Eastern Cape Province

A: Nelson Mandela Metropolitan Municipality

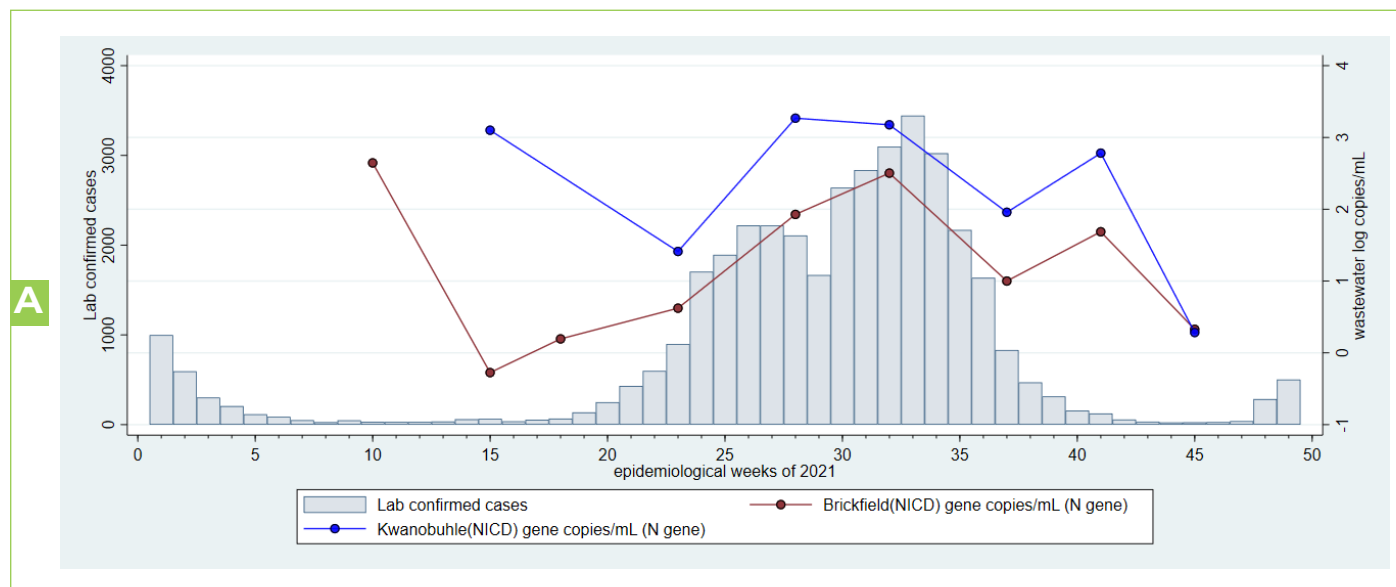


Figure 4A. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) from wastewater treatment plants (WWTPs) in Nelson Mandela Metro, Eastern Cape Province during epidemiological weeks 1-45, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory

B: Buffalo City Metropolitan Municipality

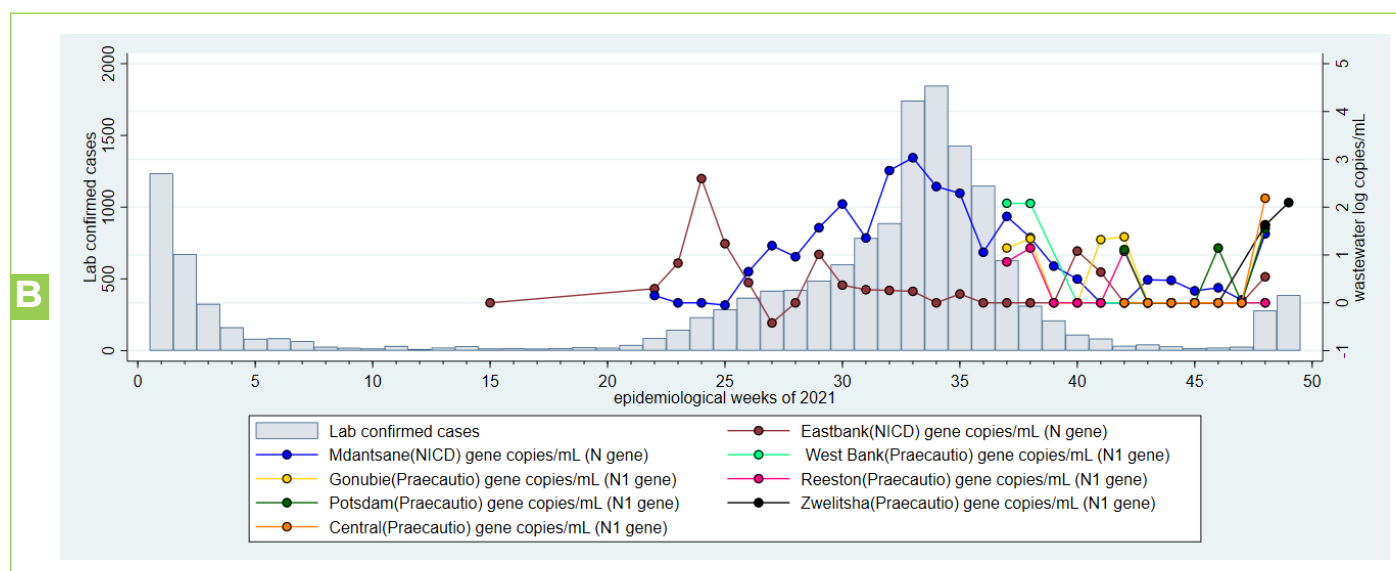


Figure 4B. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) from wastewater treatment plants (WWTPs) in Nelson Mandela Metro, Eastern Cape Province during epidemiological weeks 1-49, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

In the Eastern Cape Province, the quantitative testing of SARS-CoV-2 levels is currently being done in 10 WWTPs in Nelson Mandela Metro and Buffalo City by the NICD (n=4) and Praecautio laboratories (n=6). The NICD commenced quantitative testing in week 10 at Kwanobuhle WWTP and week 15 at Brickfield at Nelson Mandela Metro (Figure 4a). The NICD also tests two WWTPs in East Bank and Mdantsane in Buffalo City Metro, which commenced in weeks 15 and 22, 2021, respectively (Figure 4B). Praecautio commenced testing of three WWTPs (West Bank, Gonubie, and Reeston) in Buffalo City Metro in epidemiological week 37, 2021, and another three WWTPs (Potsdam, Central, and Zwelitsha) in week 42, 2021.

In Nelson Mandela Metro, assessment cannot be made due to absence of recent results. However, in Buffalo City Metro, SARS-CoV-2 levels from Zwelitsha have increased successively over two weeks with corresponding to increase in case load. The levels in Mdantsane, East Bank, Potsdam and Gonubie may be increasing, but more recent results are required. The other WWTPs have showed low or steadily decreasing levels, also requiring recent results. Readers are referred to the SA MRC wastewater dashboard for more in-depth data regarding levels of SARS-CoV-2 in wastewater plants in Nelson Mandela Metro (<https://www.samrc.ac.za/wbe/>).

Western Cape Province

City of Cape Town:

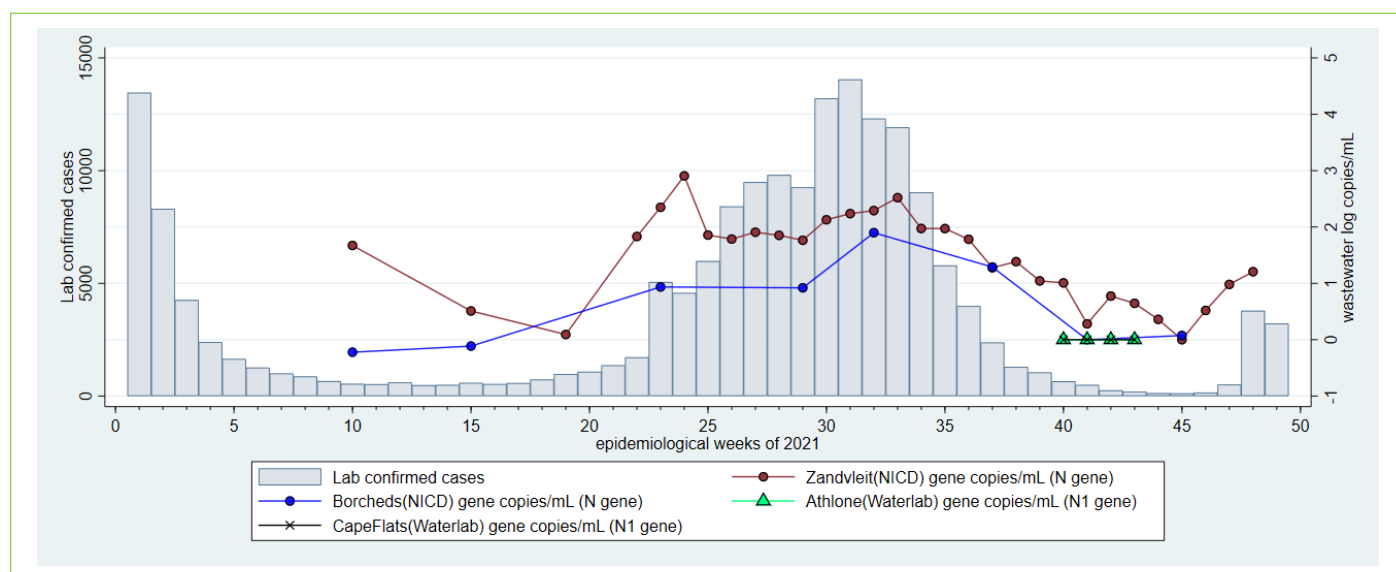


Figure 5. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/mL of wastewater (coloured lines) from wastewater treatment plants (WWTPs) in the City of Cape Town, Western Cape Province during epidemiological weeks 1-48, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP.

In the Western Cape Province, the NICD commenced quantitative testing in week 10, 2021, in two wastewater treatment plants (Borchers and Zandvleit), while Waterlab commenced testing in Athlone and CapeFlats in week 40.


The current SARS-CoV-2 levels in Zandvleit showed three successive increases between weeks 45-48 paralleling the increase in the number of clinical cases. More recent samples are required. These results should be interpreted with reference to SARS-CoV-2 epidemiology in areas draining into these treatment plants. Readers are referred to the MRC website, which provides data from additional wastewater treatment plants in the City of Cape Town and other Western Cape districts (<https://www.samrc.ac.za/wbe/>) to contextualise the results.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

Northern Cape Province

A: Namakwa District Municipality

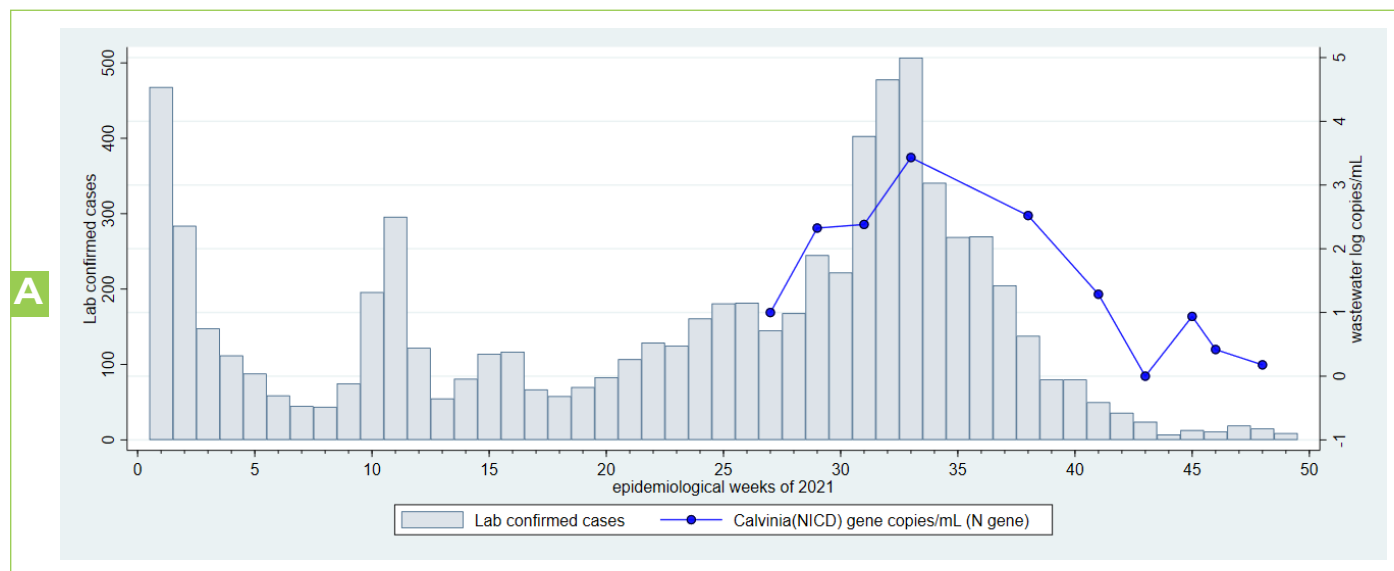

B: Frances Baard District Municipality

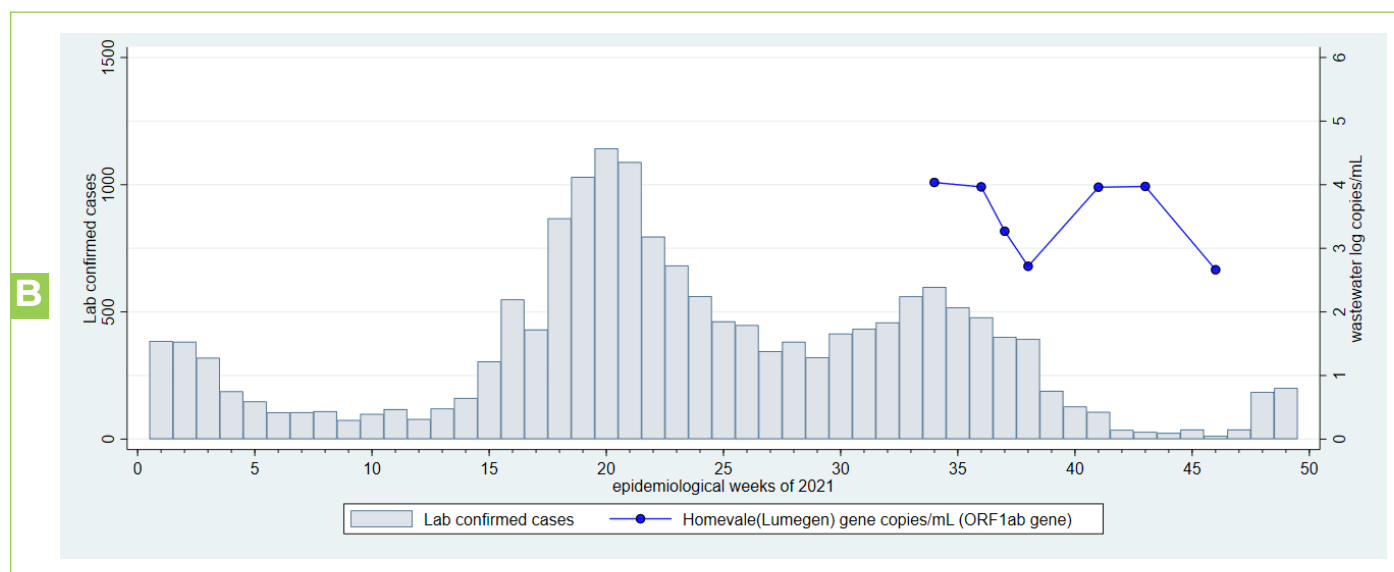


Figure 6A-B. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) in wastewater treatment plants (WWTPs) from Calvinia in Namakwa Metro (a) and Kimberly in Frances Baard District (b), Northern Cape Province during epidemiological weeks 1-48, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.


In Northern Cape province, the NICD and Lumegen laboratories commenced quantitative testing of SARS-CoV-2 levels in wastewater treatment plants in Namakwa (Calvinia) and Frances Baard (Homevale) in epidemiological weeks 27 and 34, respectively (Figure 6A-B). The SARS-CoV-2 levels were seen to be decreasing in Calvinia and Homevale WWTPs, but current samples are needed.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA


WEEK 49

North West Province

A: JB Marks Local Municipality

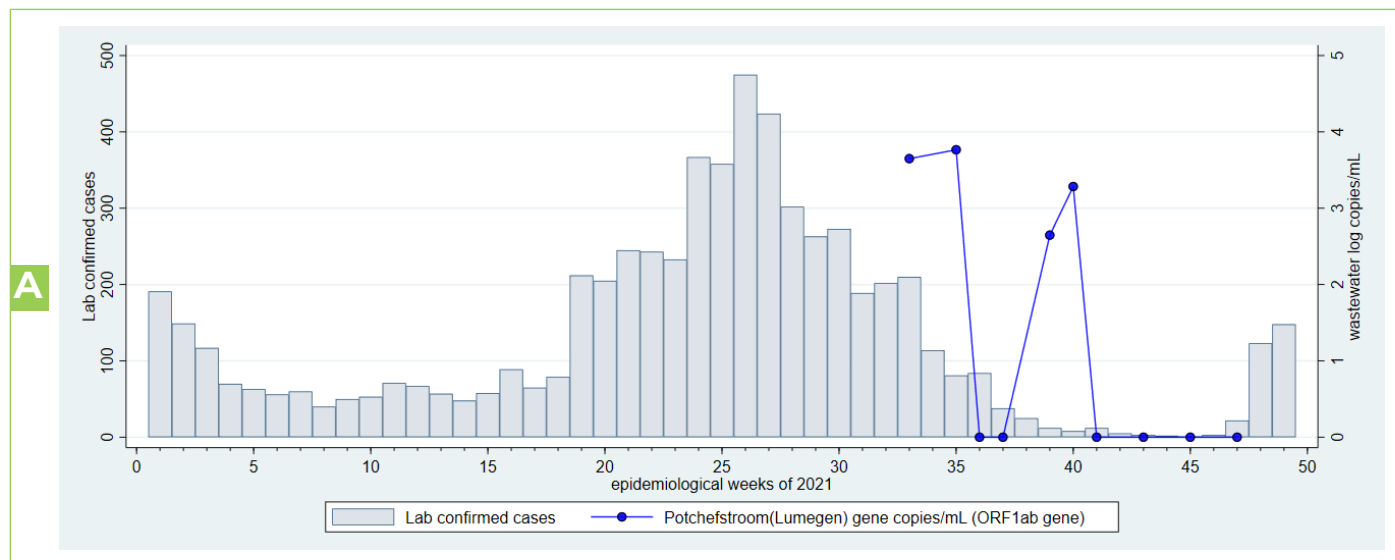

B: Bojanala District Municipality

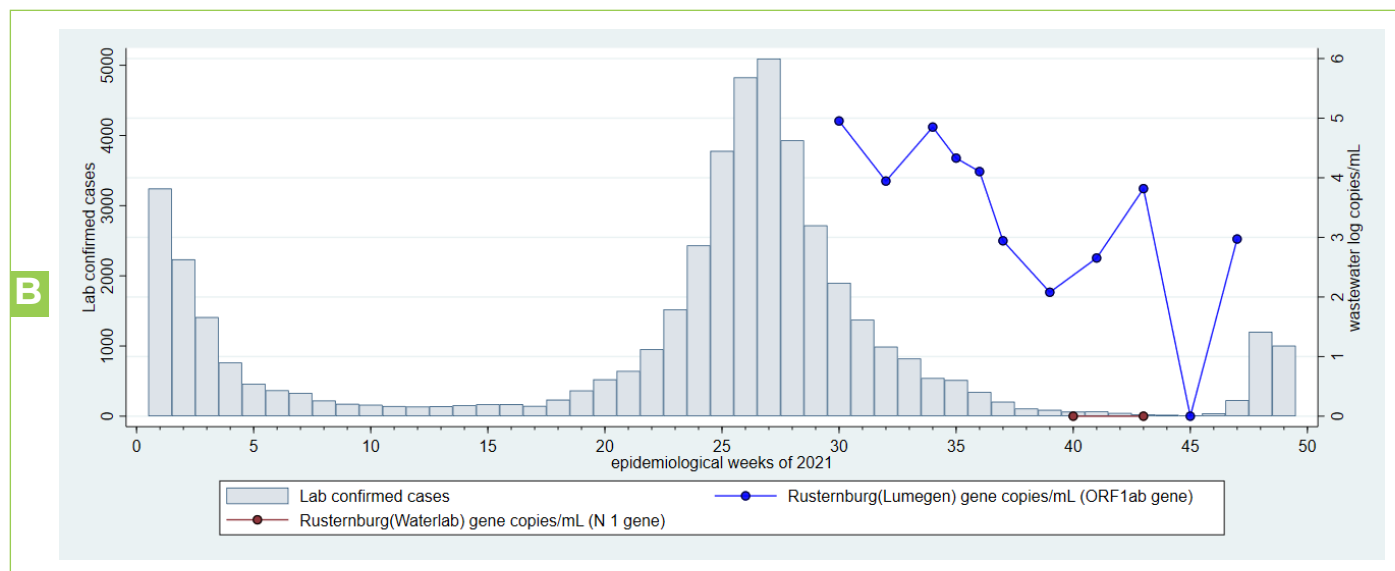

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

C: City of Matlosana Municipality

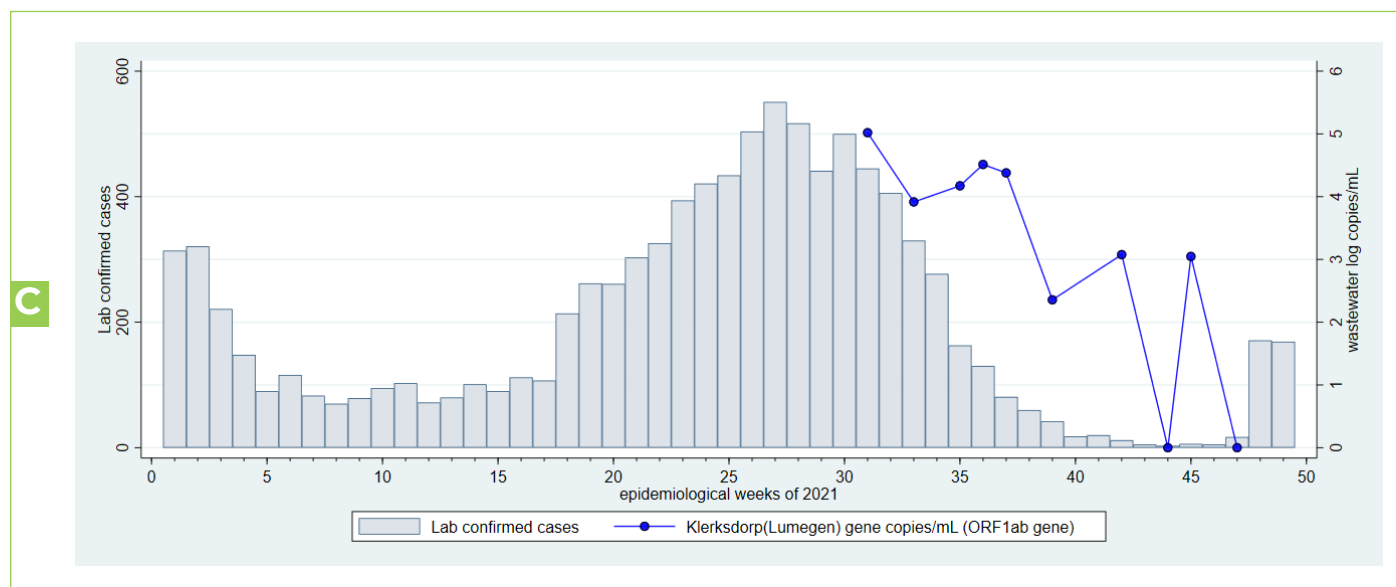


Figure 7A-C. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) in wastewater treatment plants (WWTPs) from Potchefstroom, JB Marks District (A) Rustenberg, Bojanala District (B), and City of Matlosana, Northwest Province during epidemiological weeks 31-47, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.

Three WWTPs are currently being tested in the Northwest province by Lumegen Laboratory (Figure 6a-c). Quantitative testing for SARS-CoV-2 levels in wastewater commenced in epidemiologic week 33, JB Marks Local Municipality (Potchefstroom), week 30 in Bojanala District (Rustenburg), and week 31 in City of Matlosana.


The SARS-CoV-2 levels in the WWTPs in JB Marks and Matlosana showed very low levels SARS-CoV-2 from week 44, despite the increase in the number of clinical cases. The levels in Rustenburg WWTP in Bojanala may be increasing but require more samples.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

Mpumalanga Province

Mbombela Local Municipality

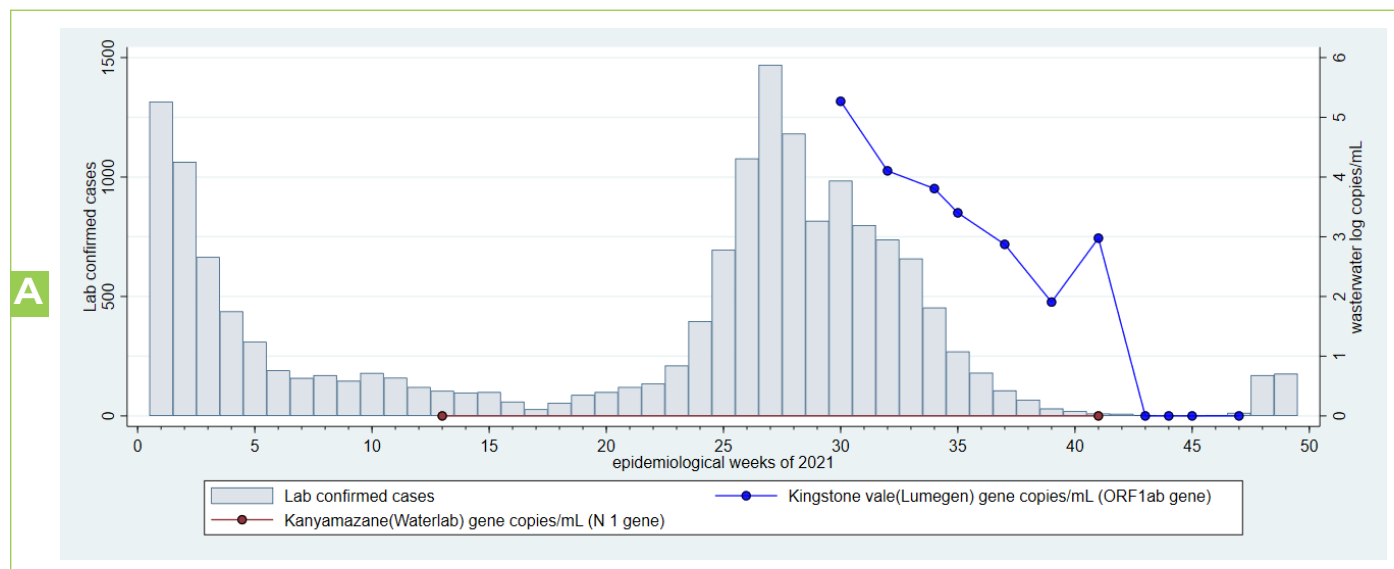

B: Emalahleni Local Municipality

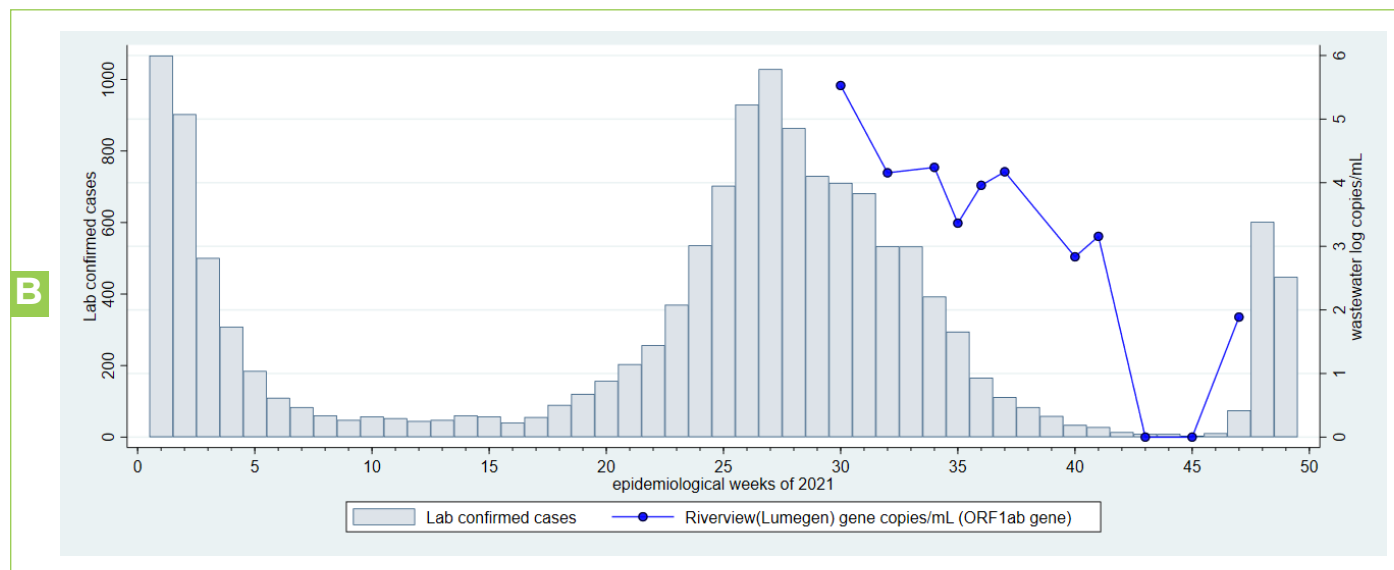


Figure 8A-B. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/ml of wastewater (coloured lines) in wastewater treatment plants (WWTPs) from Mbombela and Emalahleni Local Municipality, Mpumalanga Province during epidemiological weeks 30-45, 2021. The testing laboratory and quantified SARS-CoV-2 gene are named in brackets after the name of the WWTP. Note that comparisons of levels over time should only be made for specimens tested in the same laboratory.

In Mpumalanga, three WWTPs are being tested by Lumegen and Waterlab. Lumegen commenced the quantitative testing for SARS-CoV-2 levels in two WWTPs in Mbombela (Kingstone Vale) and Emalahleni (Riverview) Local Municipalities in epidemiologic week 30 (Figure 8a-8b). Waterlab commenced testing in epidemiologic week 39 in Kanyamazane WWTP in Emalahleni Local Municipality. With increasing numbers of clinical cases, the SARS-CoV-2 levels have been very low in Kingstone Vale and may be increasing at Riverview WWTPs. However, more current samples are needed for these areas.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

Limpopo Province

Polokwane Local Municipality

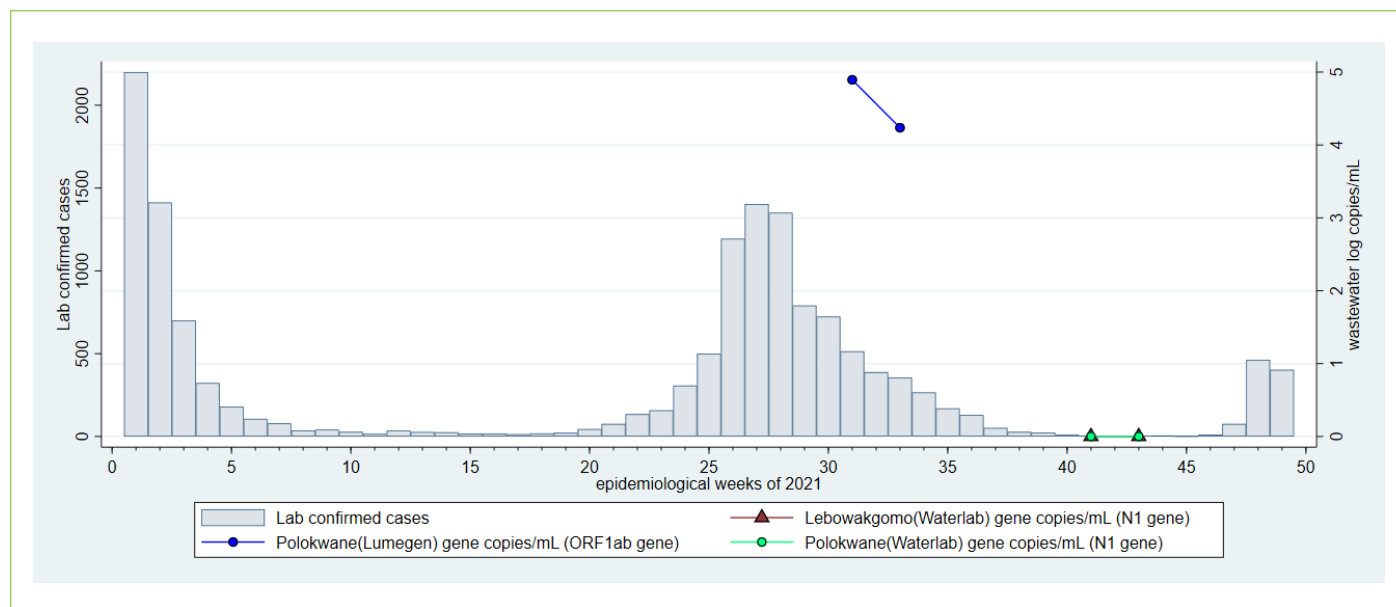


Figure 9. Laboratory confirmed cases of SARS-CoV-2 (bars) and levels of SARS-CoV-2 in log copies/mL of wastewater (coloured lines) in wastewater treatment plants (WWTPs) from Polokwane Local Municipality, Limpopo Province during epidemiological weeks 31-33, 2021.

Quantitative testing commenced by Lumegen laboratories in epidemiologic week 31, 2021, in Polokwane (Figure 9). A downward trajectory in SARS-CoV-2 levels in wastewater was seen between week 31 and 33. However, current samples are needed for this area.

WASTEWATER-BASED EPIDEMIOLOGY FOR SARS-COV-2 SURVEILLANCE IN SOUTH AFRICA

WEEK 49

LIMITATIONS

It is not possible to estimate population burden of disease using wastewater testing of SARS-CoV-2 as sources of variability are multiple, including variation in length and concentration of SARS-CoV-2 excretion by infected persons, variation in degradation rate of viral RNA in wastewater and sampling error. Interpretation of results from quantitative testing of SARS-CoV-2 in wastewater is enhanced when the population served by the wastewater treatment plants are well characterised in terms of SARS-CoV-2 testing rates, health seeking behaviour, hospital admissions and deaths due to SARS-CoV-2, as well as other general indicators of health. Further exploration of the relationship between quantitative SARS-CoV-2 results, local trends in clinical case burden, environmental factors and test methodology will support interpretation of observed fluctuations in RNA levels.

CONCLUSION

SARS-CoV-2 data from wastewater at South African sentinel sites show concordance with clinical epidemiologic curves in the respective locations, illustrating the potential of the SACCESS network to provide descriptive epidemiological data pertaining to geographic variation and burden of SARS-CoV-2.

ACKNOWLEDGEMENTS

- The contributions of local government and wastewater treatment staff to sample collection and transport is acknowledged and appreciated.
- The Water Research Commission is thanked for their vision and support.
- The NICD SARS-CoV-2 epidemiology and IT team members are thanked for sharing district and sub-district case burdens in order to generate graphs. These team members include Andronica Moipone Shonhiwa, Genevieve Ntshoe, Joy Ebonwu, Lactatia Motsuku, Liliwe Shuping, Mazvita Muchengeti, Jackie Kleynhans, Gillian Hunt, Victor Odhiambo Olago, Husna Ismail, Nevashan Govender, Ann Mathews, Vivien Essel, Veerle Msimang, Tendesayi Kufa-Chakezha, Nkengafac Villyen Motaze, Natalie Mayet, Tebogo Mmaborwa Matjokotja, Mzimasi Neti, Tracy Arendse, Teresa Lamola, Itumeleng Matiea, Darren Muganhi, Babongile Ndlovu, Khuliso Ravhuhali, Emelda Ramutshila, Salaminah Mhlanga, Akhona Mzoneli, Nimesh Naran, Trisha Whitbread, Mpho Moeti, Chidozie Iwu, Eva Mathatha, Fhatuwani Gavhi, Masingita Makamu, Matimba Makhubele, Simbulele Mdleleni, Tsumbedzo Mukange, Trevor Bell, Lincoln Darwin, Fazil McKenna, Ndivhuwo Munava, Muzammil Raza Bano, Themba Ngoben.
- The NICD Centre for Respiratory Disease and Meningitis are thanked for their assistance in setting up and troubleshooting PCR testing, and ongoing supportive collaboration.
- Staff of SACCESS network laboratories are thanked for their assistance in generating these results.

